


## 2009 WATER QUALITY REPORT



Inside This Issue:

<b>Water Quality Table</b>	<b>2-3</b>
<b>Definitions</b>	<b>3</b>
<b>Source Water Summary</b>	<b>4</b>
<b>Additional Health Info</b>	<b>4</b>
<b>Backflow &amp; Cross Connection Control Info</b>	<b>5-6</b>

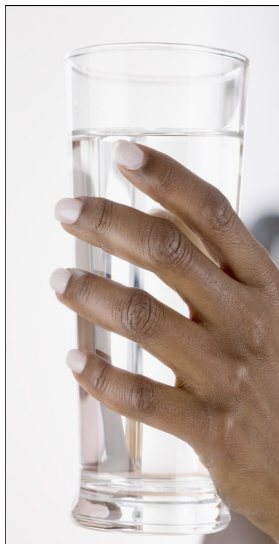

Water provided by the Village of Glen Ellyn meets or exceeds all established state and federal water quality standards.

### INTRODUCTION

The goal of this annual report, which is required by the United States Environmental Protection Agency, is to explain Glen Ellyn's water system and show results of the water quality tests conducted during 2008. This report also includes important information about water and health. We are proud to report that water provided by the Village of Glen Ellyn meets or exceeds all established state and federal water quality standards.

### OVERVIEW OF GLEN ELLYN'S WATER SYSTEM

Lake Michigan is a surface water supply. It is the sole source of water, providing drinking water to the City of Chicago and 123 suburban communities. Lake Michigan, by volume, is the second largest Great Lake and the only one located totally within the United States.

Drinking water in the Village of Glen Ellyn is supplied by the DuPage Water Commission (DWC), which purchases Lake Michigan water from the City of Chicago. Before it is purchased by the DWC, lake water is treated at Chicago's Jardine Purification Plant. After leaving the Jardine Purification Plant, the water is transferred to DWC's metering stations and then sold to Glen Ellyn. It then goes into either the water distribution system or into a water storage facility. The Glen Ellyn water distribution system consists of 146 miles of water main, 1,368 water main valves and 1,265 fire hydrants. We also have two standby ground water wells, 2 one-million gallon reservoirs and 2 elevated storage tanks with a combined 1.25 million gallon capacity.

The average pumpage to our customers is 2.75 million gallons per day. This equates to one billion gallons purchased and consumed on an annual basis, or an average of 100 gallons per day per person.

Glen Ellyn delivers high-quality drinking water. Many steps must be taken to attain this goal. Daily monitoring is conducted at all receiving stations. Each week, water samples are collected at representative locations throughout the Village and brought to an independent certified laboratory for microbiological analysis. Sample collection and facility monitoring are performed by Village staff members who are IEPA certified Public Water Supply Operators. Samples are also collected and analyzed to detect specific Volatile Organic Contaminants in the water as prescribed by federal and state regulation.

### UNREGULATED CONTAMINANTS


The Chicago Water Department has conducted monthly cryptosporidium analyses since April 1993. Cryptosporidium has not been detected in these samples. Treatment processes have been optimized to ensure that if there were cryptosporidium cysts in the water source they would be removed during the treatment process.

### SOURCE WATER INFORMATION

The sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and groundwater wells. As water travels over the surface of the land or through the ground, it can dissolve naturally-occurring minerals and radioactive material and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- **Microbial contaminants**, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife;
- **Inorganic contaminants**, such as salts and metals, which may be naturally occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming;
- **Pesticides and herbicides** which may come from a variety of sources such as agriculture, urban storm water runoff and residential uses;
- **Organic chemical contaminants**, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff and septic systems;
- **Radioactive Contaminants**, which may be naturally occurring or be the result of oil and gas production and mining activities.

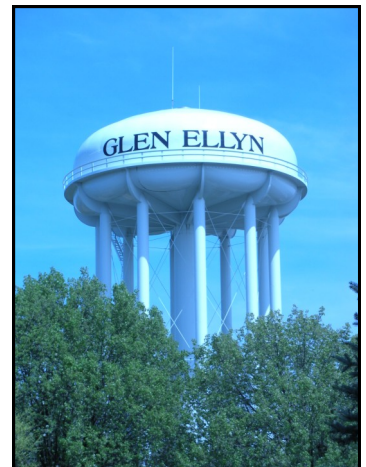

# 2009 Water Quality Table

CONTAMINANT (UNITS)	HIGHEST LEVEL DETECTED	RANGE of DETECTION	COLLECTION DATE	MCLG	MCL	Violation	Likely Source of Contamination
---------------------	------------------------	--------------------	-----------------	------	-----	-----------	--------------------------------

### Disinfectants and Disinfection By-Products

Chloramines (ppm) (1)	0.7	0.1–0.7	2008	MRDLG=4	MRDL=4	No	Water additive used to control microbes.
Haloacetic Acids (HAA5) (ppb) (1)	11	9.6–11.5	2008	No Goal for Total	60	No	By-Product of drinking water chlorination.
Total Trihalomethanes (TThm) (ppb) (1)	30	16.3–41	2008	No Goal for Total	80	No	By-Product of drinking water chlorination.

Not all sample results may have been used for calculating the Highest Level Detected in HAA5s and TThms because some results may be part of an evaluation to determine where compliance sampling should occur in the future.

### Microbial Contaminants

Total Coliform Bacteria (1)	(1 of 360) 0%	N/A	2008	0	5%	No	Naturally present in the environment.
-----------------------------	---------------	-----	------	---	----	----	---------------------------------------

### Radioactive Contaminants

Combined Radium 226/228 (pCi/l)	1.38	1.30–1.38	2008	0	5	No	Decay of natural and man-made deposits.
Gross Alpha (excluding Radon & Uranium) (pCi/l)	0.88	0.09–0.88	2008	0	15	No	Decay of natural and man-made deposits.

### Inorganic Contaminants

Barium (ppm)	0.01938	0.0191-0.01938	2008	2	2	No	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits.
Fluoride (ppm)	1.05	.92–1.05	2008	4	4	No	Water additive that promotes strong teeth; discharge from fertilizer and aluminum; erosion of natural deposits.
Nitrate (as Nitrogen) (ppm)	.321	.304–.321	2008	10	10	No	Runoff from fertilizer use; leaching of septic tanks, sewage; erosion of natural deposits.
Sodium (ppm)	8.85	8.13–8.85	2008	N/A	N/A	No	Erosion of natural deposits; used in softener regeneration.

### Unregulated Contaminants

Sulfate (ppm)	28.9	27.7–28.9	2008	N/A	N/A	No	Erosion of natural deposits.
---------------	------	-----------	------	-----	-----	----	------------------------------

### Turbidity

	Limit (Treatment Technique)	Level Detected	Collection Date	Violation	Likely source of contamination
Lowest monthly % meeting limit	0.3 NTU	100%	2008	No	Soil runoff.
Highest single measurement	1 NTU	0.14 NTU	2008	No	Soil runoff.

Total Organic Carbon (TOC) The percentage of Total Organic Carbon was measured each month and the system met all TOC removal requirements set by the EPA.

CONTAMINANT (UNITS)	MCLG	ACTION LEVEL (AL)	90th PERCENTILE	# of SITES EXCEEDING AL	COLLECTION DATE	VIOLATION	LIKELY SOURCE OF CONTAMINATION
Copper (ppm) (1)	1.3	1.3	.124	0	2008	No	Erosion of natural deposits; leaching from wood preservatives; corrosion of household plumbing systems.
Lead (ppb) (1)	0	15	0	0	2008	No	Corrosion of household plumbing systems; erosion of natural deposits.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in the drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high quality drinking water, but we cannot control the variety of materials used in plumbing components.

When your water has been sitting for several hours, you may minimize the potential for lead exposure by flushing your tap from between 30 seconds and 2 minutes before using the water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (800) 426-4791 or at <http://www.epa.gov/safewater/lead>.

### **Definitions and Footnotes for the table on this and the previous page:**

The table inside this report shows the results of our water-quality analyses based on tests conducted in 2008. Every regulated contaminant that we detected in the water, even in the most minute traces, is listed here. The table contains the name of each substance, the highest level allowed by regulation (MCL), the ideal goals for public health, the amount detected, the usual sources of such contamination, footnotes explaining our findings, and a key to units of measurement. Definitions of MCL and MCLG are important.

**Maximum Contaminant Level (MCL):** The highest level of contaminant allowed in drinking water. Maximum Contaminant Levels are set as close to the Maximum Contaminant Level Goal as feasible using the best available treatment technology.

**Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

**(1)** Results on table based upon samples collected by Village of Glen Ellyn. All other results are based upon tests conducted by the City of Chicago.

**(AL) Action Level**—The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

**(ALG) Action Level Goal** -The level of a contaminant in drinking water below which there is no known or expected risk to health. ALG's allow for a margin of safety.

**(TT) Treatment Technique** - A required process intended to reduce the level of a contaminant in drinking water.

**NTU Nephelometric Turbidity Units** - Used to measure cloudiness of the water.

**%<0.3 NTU** – Percent samples less than 0.3 NTU.

**#pos/mo** - Number of positive samples per month.

**N/A** - Not applicable.

**pCi/l** - Picocuries per liter (a measure of radioactivity).

**ppm** - Parts per million, or milligrams per liter (mg/l) or one ounce in 7,350 gallons of water.

**ppb** - Parts per billion, or micrograms per liter (ug/l) or one ounce in 7,350,000 gallons of water.

**NTU Turbidity** - Turbidity is a measure of the cloudiness of the water caused by suspended particles. We monitor it because it is a good indicator of water quality and the effectiveness of our filtration.

**Unregulated Contaminants** - A maximum contaminant level (MCL) for this contaminant has not been established by either state or federal regulations, nor has mandatory health effects language. The purpose for monitoring this contaminant is to assist USEPA in determining the occurrence of unregulated contaminants in drinking water and whether future regulation is warranted.

**Fluoride** - Fluoride is added to the water supply to help promote strong teeth. The Illinois Department of Public Health recommends an optimal fluoride range of 0.9 mg/l to 1.2 mg/l.

**Sodium** - There is no state or federal MCL for sodium. Monitoring is required to provide information to consumers and health officials that are concerned about sodium intake due to dietary precautions. If you are on a sodium restricted diet, you should consult a physician about this level of sodium in water.

**AVG** - Regulatory compliance with some MCLs are based on running annual average of monthly samples.

**MRDL Maximum Residual Disinfectant Level**- The highest level of disinfectant allowed in drinking water.

**MRDLG Maximum Residual Disinfectant Level Goal** - The level of disinfectant in drinking water below which there is no known or expected risk to health. MRDLGs allow for a margin of safety.

**NOTE:** The state requires monitoring of certain contaminants less than once per year because the concentration of these contaminants do not change frequently. Therefore, some of the results may be more than one year old.

## SOURCE WATER ASSESSMENT SUMMARY

The Illinois EPA considers all surface water sources of a community water supply to be susceptible to potential pollution problems. The very nature of surface water allows contaminants to migrate into the intake with no protection, only dilution. This is the reason for the mandatory treatment of all surface water supplies in Illinois. Chicago's offshore intakes are located at a distance that shoreline impacts are not usually considered a factor on water quality. At certain times of the year, however, the potential for contamination exists due to wet-weather flows and river reversals. In addition, the placement of the crib structures may serve to attract waterfowl, gulls and terns that frequent the Great Lakes area, thereby concentrating fecal deposits at the intake and thus compromising the source water quality. Conversely, the shore intakes are highly susceptible to storm water runoff, marinas and shoreline point sources due to the influx of groundwater to the lake. Throughout history there have been extraordinary steps taken to assure a safe source of drinking water in the Chicagoland area—from the building of offshore cribs and introduction of interceptor sewers to the lock-and-dam system of Chicago's waterways and the city's Lakefront Zoning Ordinance. The city now looks to the recently created Department of Water Management, Department of the Environment and the Metropolitan Water Reclamation District of Greater Chicago to assure the safety of the city's water supply. Also, water supply officials from Chicago are active members of the West Shore Water Producers Association. Coordination of water quality situations (i.e., spills, tanker leaks, exotic species, etc.) and general lake conditions are frequently discussed during the association's quarterly meetings. Also, Lake Michigan has a variety of organizations and associations that are currently working to either maintain or improve water quality.

Finally, one of the best ways to ensure a safe source of drinking water is to develop a program designed to protect the source water against potential contamination on the local level. Since the predominant land use within Illinois' boundary of Lake Michigan watershed is urban, a majority of watershed protection activities in this document are aimed at this purpose. Citizens should be aware that everyday activities in an urban setting might have a negative impact on their source water. Efforts should be made to improve the awareness of the storm water drains and their direct link to the lake within the identified local source water area. A proven best management practice (BMP) for this purpose has been the identification and stenciling of storm water drains within a watershed. Stenciling, along with an educational component, is necessary to keep the lake a safe and reliable source of drinking water.

We want our valued customers to be informed about their water quality. The source water assessment for our supply has been completed by the Illinois EPA. If you would like a copy of this information, please stop by the Public Works Department or call our water operator at (630)469-6756. To view a summary version of the completed Source Water Assessments, including: Importance of Source Water; Susceptibility to Contamination Determination; and documentation/recommendation of Source Water Protection Efforts, you may access the Illinois EPA website at <http://www.epa.state.il.us/cgi-bin/wp/swap-fact-sheets.pl>.



For additional copies of this report, please contact Public Works at (630) 469-6756. Copies are also available on our website.

### ADDITIONAL HEALTH INFORMATION

To ensure that tap water is safe to drink, the USEPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/CDC guidelines on appropriate means to lessen the risk of infection by cryptosporidium and other microbial contaminants are available from the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

### NATIONAL PRIMARY DRINKING WATER REGULATION COMPLIANCE

If you are interested in learning more about our drinking water or have questions, please call the Village of Glen Ellyn Public Works Department at 630-469-6756. Water Quality Data for community water systems throughout the United States is available at [www.waterdata.com](http://www.waterdata.com).

We're on the web:  
[www.glenellyn.org](http://www.glenellyn.org)